

A Higher Level of Performance



User Manual

Centurion

Guided Radar

CGR Series



For more information, please visit >

www.hawkmeasure.com





Overview	3	Software Parameters	21
Principle of Operation	3	Setup Menu	21
Function	3	Digitize Function	22
Features	3	Measured Range Reference	22
Primary Areas of Application	3	Advanced Menu	23
		SIL Commission Menu	24
Wiring & Dimensions	4	Interface Mode	25
Wiring Terminal Compartment	4		
Dimensions - Housing	4	Setup Procedure	26
		Commissioning	26
Dimensions	5	SIL2 Commissioning	26
Dimensions - Probe Variants	5		
Cable Weight Tank Fastening Kit	6	HART	27
		HART Information / DD	27
Detached Probe Assembly	7	HART Variables	27
Instructions for Assembling Detached Probe	7	HART Universal Command List	27
Rope Weight	7	HART Common Practice List	28
		Status / Diagnostic Flags	28
Safety Instructions	8	Software Flow Chart	29
Safety Instructions	8		
SIL Safety Instructions	8	Software Flow Chart - SIL2	33
Installation Guide	9	Troubleshooting	38
Mounting - Instruction for Rotating the Unit	9	Failed codes	38
Placement Requirements	10	General Troubleshooting	39
Nozzle / Socket Mounting	10	Troubleshooting (con't)	40
Stand Pipe / Flanged Mounting	11		
Mounting - Conductive Vessel	12	Part Numbering	41
Mounting - Non Conductive Vessel	12	Centurion Guided Radar System	41
Conduit / Gland Entry Wiring	12	Centurion Guided Radar System	43
Securing The End of The Probe	13		
Flexible Probe Movement	13	Flange Table	45
		Mounting Flanges	45
Hardware Adjustment	14	Accessories	45
Adjusting Probe Length	14		
Enclosure (Display) Orientation for Hazardous Rated Units	15	Specifications	46
Enclosure (Display) Orientation for Non-Hazardous Rated Units	16		
		Ordering Instructions	49
Forces On The Probe	17		
Powering The Unit For The First Time	18		
Displayed Measurements	19		
Displayed Diagnostics	20		

Overview

Centurion Guided Radar



Principle of Operation

Guided-wave technology sends the radar pulse down a probe to measure either liquids, solids or a low dielectric to high dielectric Interface level.

The pulse hits the surface and / or Interface and is reflected back up the probe to the sensor, where the transit time is translated into a distance using time of flight and time expansion.

The amplitude of the reflection depends on the dielectric constant of the product.

Function

The HAWK range of Guided Radar products are ideal for the measurement of liquids, sludge, powders and granules to a range of 18.5m for level and interface. This technology is not affected by pressure, temperature, viscosity, vacuum, foam, dust, changes in dielectric constant or coating of the probe.

Primary Areas of Application


- Chemicals
- Petrochemicals
- Cement
- Building Aggregates
- Mining / Minerals
- Food & Beverages
- Oil & Gas
- Pharmaceutical
- Pulp & Paper
- Wastewater

Features

- Hazardous rated ICECEX, FM, CSA & ATEX Gas & Dust
- Safety rating to SIL2, SIL3 (multi channel)
- Interface Level measurement option
- Up to 18.5m (60ft 8in) range
- Very short minimum range ($\leq 150\text{mm}$, 6")
- Simple setup
- Auto-Calibration to any dielectric ≥ 1.5
- Adjustable Sensitivity
- Precise & continuous accuracy
- 2 wire loop
- 4-20mA, HART 7
- Protection class IP66, NEMA 4x
- Measures extremely low dielectric (1.5)
- Programmable fail safe mode



Wiring Terminal Compartment



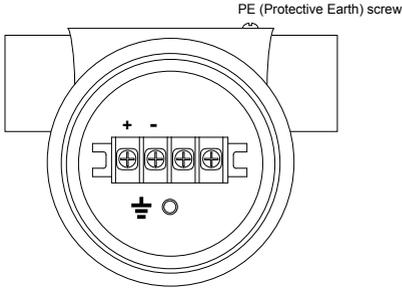


Dimensions - Housing


Dual Chamber

Process Temperature
 $\leq 130^{\circ}\text{C}$ (266°F)

Process Temperature
 $150^{\circ}\text{C} \geq 250^{\circ}\text{C}$ ($302^{\circ}\text{F} \geq 482^{\circ}\text{F}$)

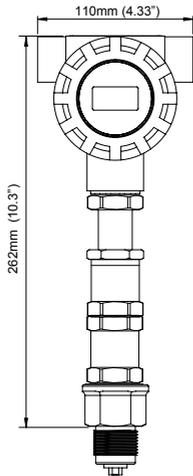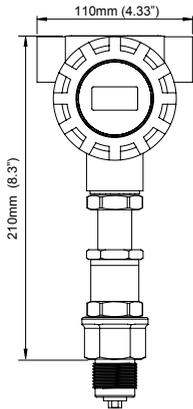

Single Chamber

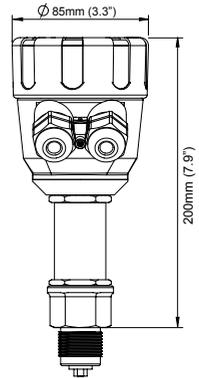



Dimensions - Probe Variants

A04 / A06 / A08 / J04 / J06 / J08





B04 / B06 / B08 / K04 / K06 / K08

Threaded

Integrated Flange

Threaded

Integrated Flange

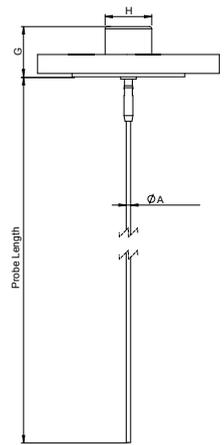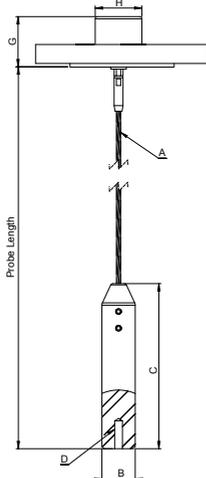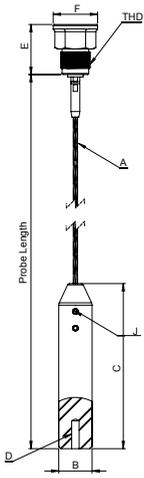

Probe / Cable Dimensions


Probe Type	THD BSP or NPT	A		B		C		E		F		D Internal Threads (A04, A06, A08 only)	J (Tightening Torque = 20Nm)	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.		Set Screw	Hex Key Size
A04, B04, J04, K04	3/4	4	0.16	22	0.9	120	4.7	45	1.8	40	1.6	M10x1.25, 24mm deep	3x M8x1.25x12	4mm
A06, B06, J06, K06	1	6	0.24	28	1.1	150	5.9	45	1.8	40	1.6	M10x1.25, 24mm deep	3x M8x1.25x12	4mm
A08, B08, J08, K08	1-1/2	8	0.31	36	1.4	200	7.8	72	2.8	64	2.5	M10x1.25, 24mm deep	3x M10x1.5x18	5mm
	Integrated Flange	G		H										
		mm	in.	mm	in.									
A04, B04, J04, K04		45	1.8	42	1.6									
A08, B08, J04, K04		72	2.8	70	2.7									



Cable Weight Tank Fastening Kit

The tank fastening kit (CGR-A0X-WL-SS) includes 2 eye bolts and 1 adjustable rigging lock.


Rigging Lock

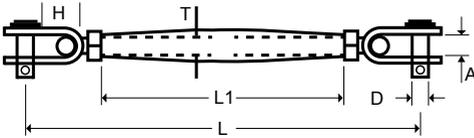

Dimensions	
T (thread)	M12
A	14mm (0.55")
D	12mm (0.47")
H	25mm (0.98")
L	252mm (9.9")
L1	150mm (5.9")

Recommended Working Load	983kg (1.05 ton)
Total Deformation Load	3750kg (4.13 ton)
Weight	576g (1.27lb)

Eye Bolt






Dimensions	
T (thread)	M10
A	40mm (1.57")
B	25mm (0.98")
C	21mm (0.82")
D	20mm (0.79")
H	63mm (2.48")


Recommended Working Load	675kg (0.74 ton)
Total Deformation Load	2600kg (2.87 ton)
Weight	60g (0.13lb)



Instructions for Assembling Detached Probe

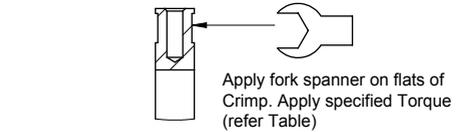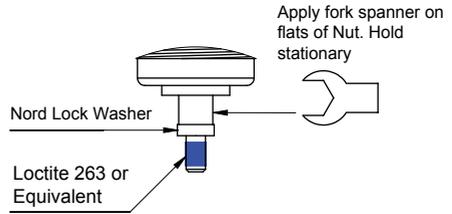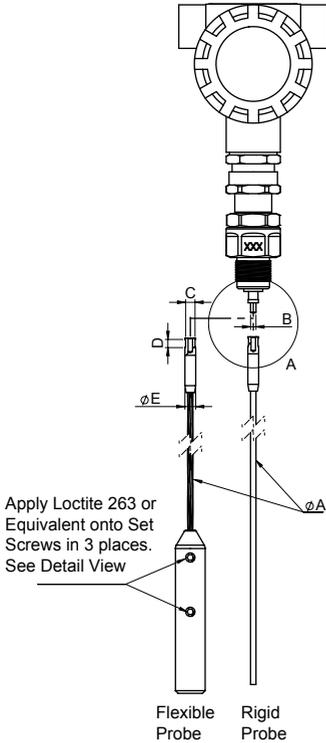

Rope Weight

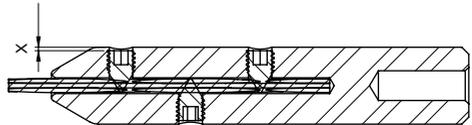

Note: Only Probes supplied by HAWK can be fitted in situ. Mounting of any other probe voids Hazardous Location Approval

Probe	Ø A(mm)	B(mm)	C(mm)	D(mm)	Ø E(mm)	T. Torque
J04, K04	4	M4	7	6	8	5 Nm
J06, K06	6	M6	10	6	11	10 Nm
J08, K08	8	M10	15	10	16	20 Nm

Set Screws on Rope Weight

Probe	Set Screw	Length	X	Torque
J04, K04	3XM8X1.25	12mm	1mm	20 Nm
J06, K06	3XM8X1.25	12mm	3mm	20 Nm
J08, K08	3XM10X1.5	18mm	3mm	20 Nm



Safety Instructions

For installation requirements for Hazardous Locations please refer to appropriate Safety Instruction document located at:

<http://www.hawkmeasure.com/productdetail.asp?id=57>

SIL Safety Instructions



Please consult SIL User & Safety Manual for critical information regarding setup & commissioning of SIL installations.




Mounting - Instruction for Rotating the Unit

There are specific rotation points which should be used while mounting the unit into place.

The Housing Compartment should never be used to rotate the device during mounting.

For rotating the housing after installation see 'Rotating the Enclosure' section.

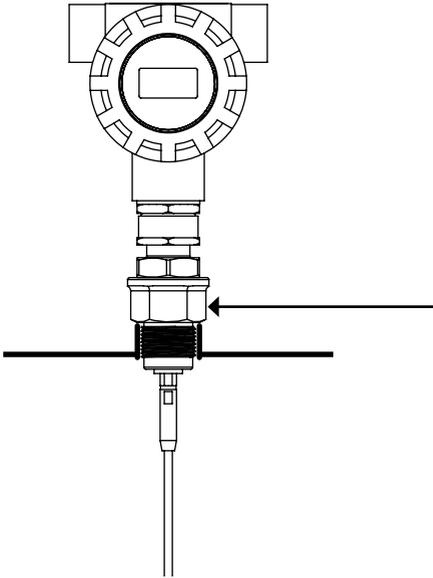


When Installing the CGR unit,
use spanner or wrench **ONLY** at
Process Fitting as indicated.




Placement Requirements

Do **NOT** mount near infeed

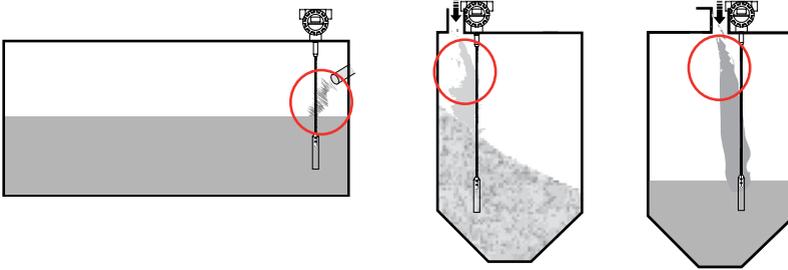


Do **NOT** mount over or adjacent to any obstacles

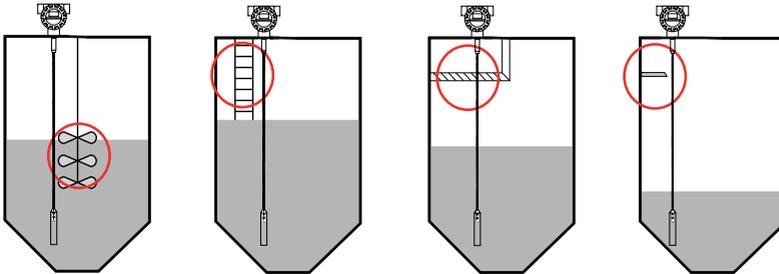



Nozzle / Socket Mounting

Avoid Nozzle / Socket protruding into vessel

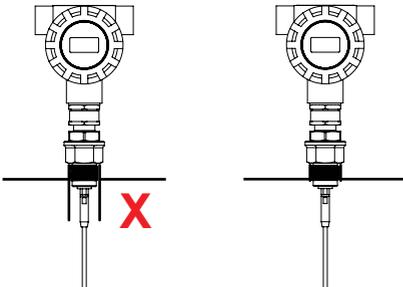




Stand Pipe / Flanged Mounting

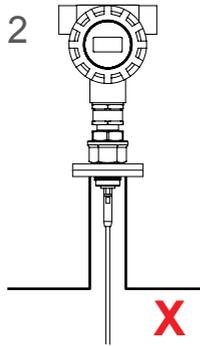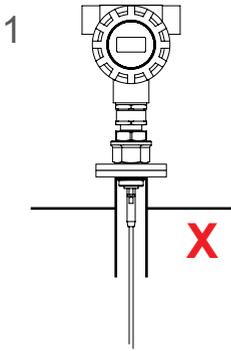

1. Stand pipes protruding into vessel may cause signal interference. Digitisation and / or Blanking Distance must be adjusted to avoid measurement issues

2. Long / narrow stand pipes may cause signal interference. Digitisation and / or Blanking Distance must be adjusted to avoid measurement issues

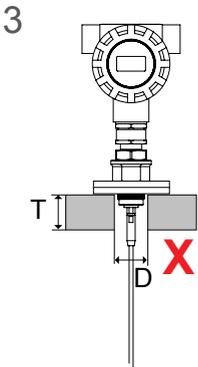

3. Roof Thickness (T) should not exceed Diameter (D) of cut away. Digitisation and / or Blanking Distance must be adjusted to avoid measurement issues




Mounting - Conductive Vessel

Guided Radar functional performance is most optimized when there is a ground reference between the mounting (metal flange or thread) and the vessel. Metallic or metal reinforced vessels are ideal.


Mounting - Non Conductive Vessel

A non conductive vessel will require a conductive metal strip or equivalent connected to the metal flange or thread and running along side the vessel for at least the Probe insertion length. A conductive metal sheet (min 0.5m (8")) should also be mounted on the roof and be in contact with metal thread or flange.

If a seal / gasket is used between the flange and the vessel ensure non coated / painted bolts are used to create ground reference with vessel.

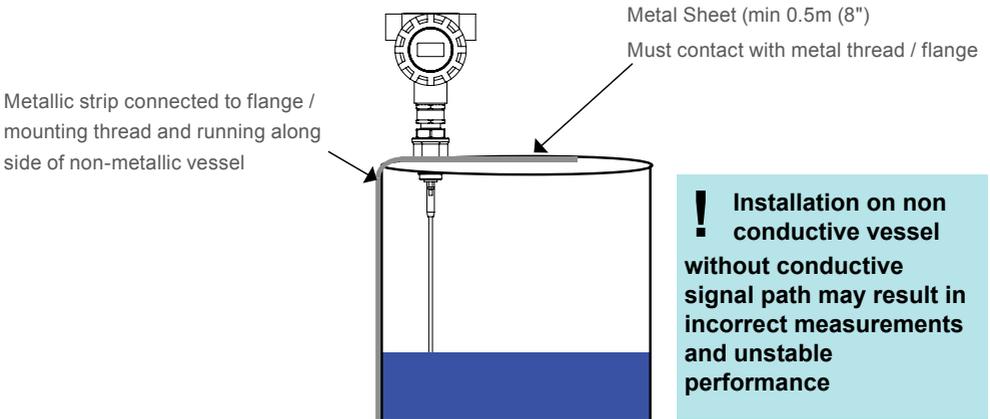


Conduit / Gland Entry Wiring

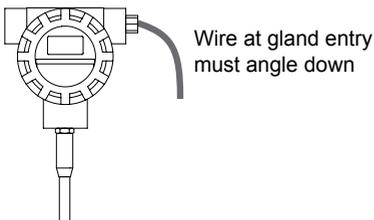




Securing The End of The Probe

- Securing the end of rigid probes is not required unless there is risk of excessive lateral forces.
- Securing flexible cable weight via M10 thread on base of weight is recommended to prevent movement.

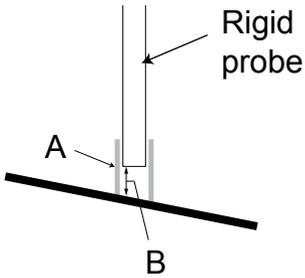



A	Metal socket
B	Floor clearance (min 50mm, 2")

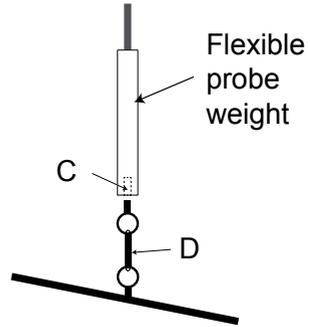

C	M10 thread
D	Cable Weight Fastening Kit or appropriate O ring & link secured to vessel floor.

Flexible Probe Movement

- Avoid mounting adjacent to internal structures (eg ladders, walkways). The cable must not make contact with any part of the vessel
- Take into consideration that material forces may push probe laterally. Secure Cable Weight if required.

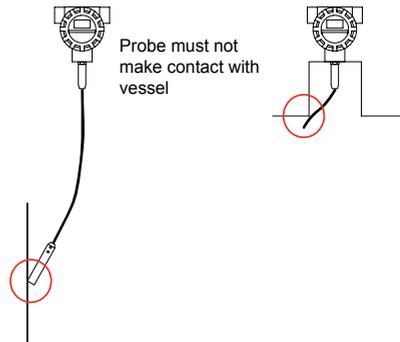



Adjusting Probe Length

Rigid Probes

Cut rigid probes to appropriate length. After adjustment, you must change the 'ProbeLength' Parameter in 'Advanced' menu to represent the new length (password 222).

Flexible Probes

- (a) Mark the point at which the flexible cable enters the cable weight.
- (b) Release the cable weight grub screws with hex key.
- (c) Measure and note the length of cable concealed within cable weight.
- (d) Cut cable noting the length of cable must include the concealed length above.
- (e) Re-insert the cable into the weight and tighten grub screws to tightening Torque of 20Nm.
Use loctite 243 or equivalent on grub screws to secure once completed.
- (f) Adjust ProbeCalibr Parameter in 'Advanced' menu to represent new length (password 222).



Enclosure (Display) Orientation for Hazardous Rated Units



Please consult relative Safety Instructions for critical information regarding rotating Hazardous Rated units



Enclosure (Display) Orientation for Non-Hazardous Rated Units

The conduit fitting which couples the sensing probe to the enclosure provides a Union Joint which is designed to rotate.

However this rotation is limited to one-time adjustment of Display orientation after installation on site, as shown below:

ONLY one 36mm spanner applied to the Hex of Union Joint to rotate enclosure to desired orientation as allowed. DO NOT hold the enclosure during this procedure.

As Installed, but LCD display not visible.



Rotation at Union Joint

Max 360° allowable one-time rotation in either direction.



Desired Orientation.



Rotation beyond these strict limits can damage the internal cables

Ensure Enclosure follows the spanner rotation and assembly integrity is not compromised



Forces On The Probe

Tensile forces are heavily dependent on the viscosity and abrasive characteristics of the product in the vessel. Ensure tensile loading is appropriate for the selected cable as well as the silo cover and mounting structure. In critical cases it is better to select the larger flexible cable (8mm).

Probe Type	Tensile Load
A04 / J04 (4mm flexible cable @ 20°C, 68°F)	0.5 Ton
A06 / J06 (6mm flexible cable @ 20°C, 68°F)	1.0 Ton
A08 / J08 (8mm flexible cable @ 20°C, 68°F)	4.0 Ton

Lateral forces can exist due to movement and gradual flow of the product in the vessel, particularly with powder and granular materials.

These forces can cause stress and strain on the probe, as well as the process fitting and mounting hardware. Ensure that lateral forces are minimized by following the installation guidelines and Placement Requirements.

Probe Type	Lateral Load
B04 / K04 (4mm rigid probe @ 20°C)	1 Nm
B06 / K06 (6mm rigid probe @ 20°C)	3 Nm
B08 / K08 (8mm rigid probe @ 20°C)	8 Nm

Powering The Unit For The First Time

Centurion Guided Radar



Installation should only be performed by suitably qualified personnel.


- A. Confirm mounting is within recommended specifications.
- B. Check the selected unit matches the required application specifications.
For Hazardous Locations see appropriate safety instructions available at <http://www.hawkmeasure.com>
- C. Check the wiring is correct and all connections are secure.
- D. Apply power to the unit.

When power is applied the unit will start its normal load sequence.
The following messages will cycle on the display.

Hawk
CGR Series
Serial Number
Software Revision

Menu Navigation

- 1  Navigate up, increase value
- 2  Navigate down, decrease value
- 3  Proceed, select, save
- 4  Go back, return unit to operational mode

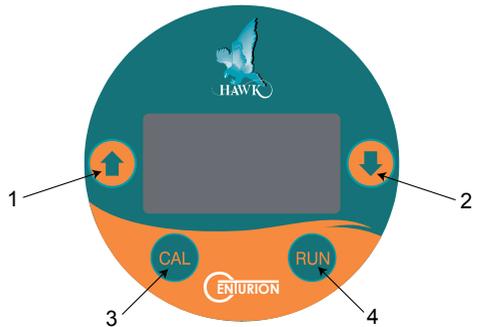




Displayed Measurements - Level

Measured Span Reference


A	Distance - measured from base of thread or bottom of flange to material level
B	Level - measured from Low level to material level
C	% Level - proportional percentage of measured level based on Low and High level setting

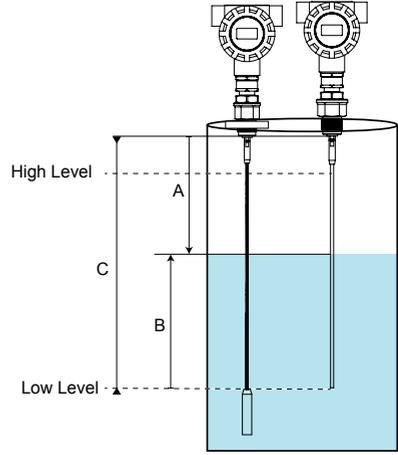

Displayed Measurements - Interface¹

Measured Span Reference

A	Distance - measured from base of thread or bottom of flange to material level
B	Level - measured from Low level to material level
C	% Level - proportional percentage of measured level based on Low and High level setting

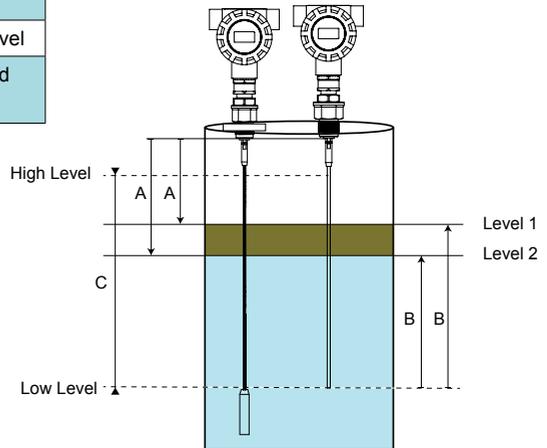


⁽¹⁾Interface mode is only available with the Interface communications option (see Part Numbers)



Displayed Diagnostics

While pressing the arrow buttons the top corner of the display cycles through various unit diagnostics

mA	Simulated current output in mA
Normal	Unit operating normally
Failed	Unit in failsafe condition
Recover	Unit searching for level / attempting to amplify signal
⁽¹⁾ Level - 1	Upper Material Level measurement
⁽¹⁾ Level - 2	Lower Material Level measurement
⁽²⁾ SILEnable	SIL mode enabled (SIL2 units only)
⁽²⁾ SILDsable	SIL mode disabled (SIL2 units only)



⁽¹⁾Interface mode is only available with the Interface communications option (see Part Numbers)

⁽²⁾SIL2 rated units only (see Part Numbers)



Setup Menu

- Main Menu
- ▶ Setup
- Advanced
- Autoset

- (1) See 'Measured Range Reference' on next page
- (2) Volume activation requires GosHawk. See dedicated CGR GosHawk manual.
- (3) Units with Interface software option only

Parameter	Description	Options
Display Mode	Select default Display mode	Volume ⁽²⁾ Level %Level Distance
Display Unit	Adjust displayed measurement unit	Centimeters Metres Feet Inches
Low Level	Set Low Level (4mA) distance	Adjustable
Hi Level	Set High Level (20mA) distance	Adjustable
Damping	Adjust output response time & smoothness	Adjustable
Digitize	The 'Digitize' function is an automatic setup routine used to eliminate false reflections. For optimum performance the unit lids must be closed. See 'Digize Function' for further information.	<ul style="list-style-type: none"> • Yes • No • Disable
Tracking	<p>Program application Fill and Empty speeds.</p> <p>InstaTrack is a special mode which we respond immediately to any detected reflection.</p> <p>'Test' Mode adjusts unit function to be suitable for bench testing and demonstration. The unit will track nearest detected reflection regardless of size.</p>	<ul style="list-style-type: none"> • Fast • Medium • Slow • InstaTrack • Test
Dielectric	Applies a pre-set value to Sensitivity based on selected Dielectric Constant of material. For Interface units this should be the Upper Layer.	• Adjustable
Interface ⁽³⁾	Enable / Disable Interface measurement mode. See 'Interface Mode' section for more information	• Enable / Disable
Fail Mode	Set Analogue failsafe output	3.80mA > 20.20mA LastKnown 4mA 20.00mA > 21.50mA
Fail Time	Set time delay for FailSafe condition (in seconds)	Adjustable

(1)



Digitize Function

The 'Digitize' function is an automatic setup routine to create a digital map of false echoes generated by problems such as non-recommended mounting.

The function should be performed after physical installation to the application and while the lids are closed.

During the process the unit will prompt a measured distance (this must be either the material level if material is touching the probe, or end of probe of the vessel is empty. For **Interface** model type it must be the Upper Layer). The distance is adjustable if the displayed distance is not correct.

Ensure the value is not greater than the distance to the material level.

For best results follow this routine:

- 1) Ensure the unit is mounted according to mounting specifications and requirements.
- 2) Ensure the material to be measured is in contact with the actively measured part of the probe.
- 3) Select Dielectric value of most similar to material to be measured. For **Interface** model type it must be the Upper Layer).
- 4) Run Digitize routine. Confirm displayed distance is either material level.
- 5) Close unit lid during timer count down

Measured Range Reference


A	Blanking (non-measurable zone)
B	Measurable Span (blanking to top of cable weight or end of rigid probe). High level must be = to or > than Blanking

Minimum Recommended Range

Probe Variant	Distance
A04 / J04	150mm (6")
A06 / J06	150mm (6")
A08 / J08	150mm (6")
B04 / K04	150mm (6")
B06 / K06	150mm (6")
B08 / K08	150mm (6")

Maximum Range

Probe Variant	Distance
A04 / J04	18.5m (60ft 8in)
A06 / J06	18.5m (60ft 8in)
A08 / J08	18.5m (60ft 8in)
B04 / K04	4m (13ft 1in)
B06 / K06	4m (13ft 1in)
B08 / K08	4m (13ft 1in)

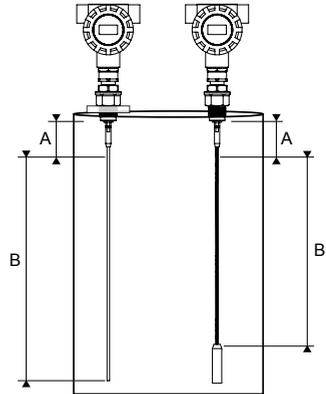



Advanced Menu

Main Menu Setup ▶ Advanced Autoset

Parameter	Description	Options
Comms	Adjust communication protocol settings. The default ID is 0, and the default baud rate is 1200.	<ul style="list-style-type: none"> • Device ID • Baud Rate
Sensitivity	Manual adjustment of Sensitivity. Dielectric selection automatically sets this value to defaults based on the Dielectric selection. Sensitivity is the primary adjustment for the unit's ability to detect media. A higher value is used for lower Dk materials or more difficult applications.	<ul style="list-style-type: none"> • 0-100
Blanking	Blanking is a non-measurable zone. This can be increased to 'Blank' out high level false echoes caused by mounting	<ul style="list-style-type: none"> • Adjustable • <150mm (6") is not recommended
Analog	Adjust Analog output. Switch from 4-20mA to 20-4mA Fine tune both 4mA current and 20mA current reading Park (Lock) Current to 4, 8 or 12mA.	<ul style="list-style-type: none"> • 4-20 • 20-4 • 4mA tuning • 20mA tuning • Park 4mA • Park 8mA • Park 12mA
Scope	Allows viewing of a scope type live signal trace. Scope Sens adjusts the amplification of the visible trace where 0 is the most amplification	Scope View Scope Sens
Factory Reset	Restore all parameters to factory default.	<ul style="list-style-type: none"> • Yes • No
Device Info	Display device information	
Lock Code	Enable / Disable lock code. If enabled, select lock code number.	<ul style="list-style-type: none"> • Enable / Disable
ProbeCalibr	If physical length of probe is adjusted you must run this routine for the system to re-detect the probe end. Nothing should be touching the probe when commencing this function.	<ul style="list-style-type: none"> • Adjustable • Password protected (222)
ProbeFault	Probe Fault will activate Failsafe in the event of a missing Probe	<ul style="list-style-type: none"> • Enable / Disable
Dist Calibr	Calibrate distance correction factor. Some applications or environments can affect time of flight signal travel affecting the measured distance reading. This function allows the detected distance to be adjusted to suit the application.	<ul style="list-style-type: none"> • Adjustable



SIL Commission Menu

- Main Menu
- ▶ SILCommission
- Setup
- Advanced



Please consult SIL User & Safety Manual for critical information regarding setup & commissioning of SIL installations.



Interface Mode Setup

Interface mode is only available with the Interface communications option (see Part Numbers).

The Interface mode is designed to measure applications with low to high dielectric constant layers.

The transmitted signal reflects off the Upper Layer and continues through the Interface and reflects from the Lower Layer.

The unit provides a level reading for both the Upper and Lower Layers available via HART. The Upper Layer will always be transmitted to the 4-20mA output.

When Interface mode is Enabled, the following parameters are adjustable.

Parameter	Description	Options
DK Comp	Set dielectric of interface layer. This adjusts the velocity compensation for the transmitted signal as it passes through the interface. Default 2.22	• 0-100
IFace Width	Set water reading (level 2) offset in the event of a merged echo. A merged echo will occur if the interface is too thin to produce a separate echo. The offset is measured from the end of the merged echo backwards. Default 150mm (0.5ft) <i>Note: This is an advanced setting and should not be adjusted without expert knowledge</i>	• Adjustable
IFace Size	Sets the echo size (in signal voltage) to dictate whether an echo is from the Interface or Level. If the echo is larger than the value the unit will assume no Interface is present and will set Level 1 reading to be the same as Level 2 reading. If the echo is smaller it will assume there is only an Interface layer measurable and will set Level 2 to end of probe measurement. Default 2.34 <i>Note: This is an advanced setting and should not be adjusted without expert knowledge</i>	• 0-2.49



Commissioning

For commissioning via PC and GosHawk see dedicated CGR GosHawk Manual.

Parameter	Instruction
1. Set High and Low level	High and Low level distances can be programmed manually or you can run Autoset. Autoset can be used to program the High or Low level based on the material level which is touching the probe when the function is run.
2. Set Tracking Speeds	Tracking speeds can be set to Fast, Medium, Slow and Custom (measured in Displayed Units per hour)
3. Select application Dielectric	Choose closest Dielectric range from the pre-set list. Select lower value if unsure.
3. Run Digitize	Confirm displayed distance is either material level (for Interface applications it must be the Upper Layer) or end of probe if vessel is empty. <u>Ensure the value is not greater than the distance to the material level.</u> See 'Digitize Function' for additional critical information.
4. Add Damping	Increasing Damping value if a smoother response trend is required. This value is automatically set by the Tracking speed.
5. Run unit	Press RUN several times to commence unit operation

SIL2 Commissioning



Please consult SIL User & Safety Manual for critical information regarding setup & commissioning of SIL installations.



HART Information / DD

HART Revision 7

DTM/DD files available at <http://www.hawkmeasure.com/downloads.asp> in 'Drivers' section.

Supported hosts include PRM, Fieldmate and AMS. DD files for the 475 Communicator are available.

HART Variables

Variable	Function	Function (for Interface model type)
Primary	Level	Level 2
Secondary	Unfiltered echo distance	Level 1
Third	Echo signal size	Level 2 echo signal size
Fourth	Temperature	Temperature

HART Universal Command List

Command No.	Function
0	Read unique identifier
1	Read Primary Variable
2	Read current and percent of range
3	Read current and four predefined dynamic variables.
6	Write polling addr
7	Read loop configuration
8	Read Dynamic Variable Classifications
11	Read unique ident. Associated with tag
12	Read message
13	Read Tag, Description, Date
14	Read PV sensor information
15	Read output information
16	Read final assembly number
17	Write message
18	Write Tag, Description, Date
19	Write final assembly number
20	Read Long Tag



HART Common Practice List


Command No.	Function
34	Write Primary Variable Damping Value
35	Write Primary Variable Range Value
36	Set Primary Variable Upper Range Value
37	Set Primary Variable Lower Range Value
38	Reset Configuration Changed Flag
40	Enter/Exit Fixed Primary Variable Current Mode
44	Write Primary Variable Units
45	Trim Primary Variable Current Dac Zero
46	Trim Primary Variable Current Dac Gain
57	Read Unit Tag, Descriptor, Date
58	Write Unit Tag, Descriptor, Date
59	Write Number Of Response Preambles
109	Burst Mode Control
110	Read All Dynamic Variables

Status / Diagnostic Flags


Status / Diagnostic Flags
Device Malfunction (Fails safe status)
Configuration Changed
Cold Start
Output Current Fixed
Primary Variable Out of limits




Diagnostics

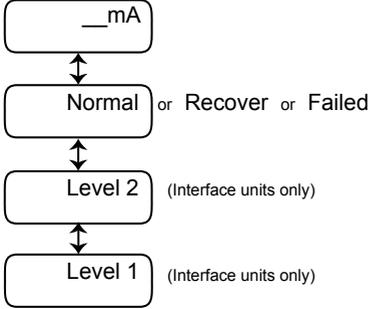



Autoset

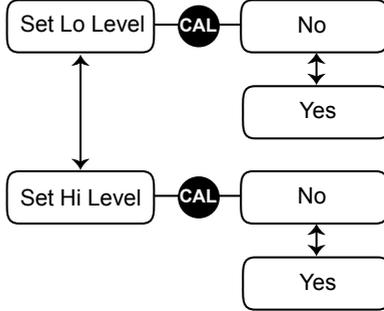


Setup

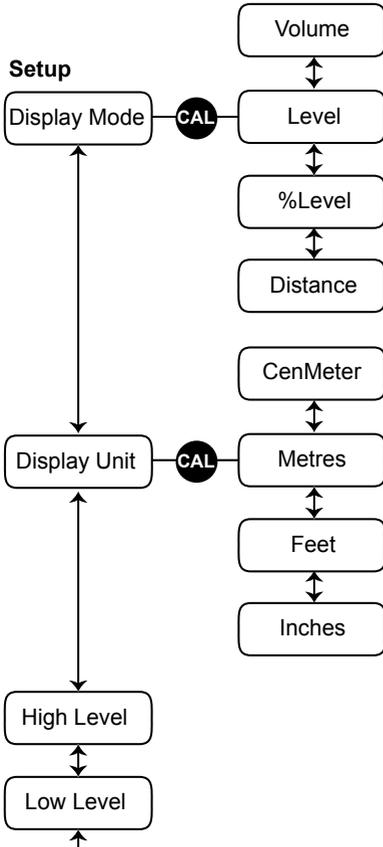


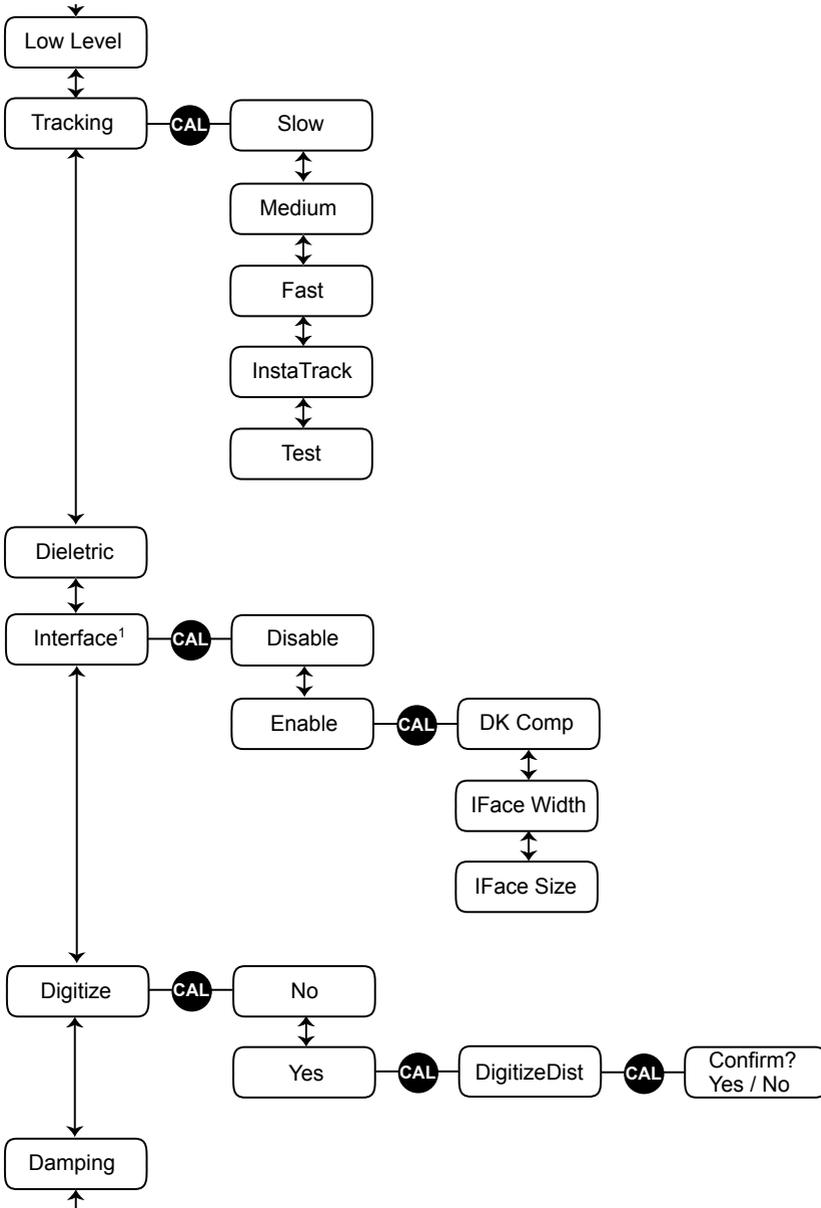

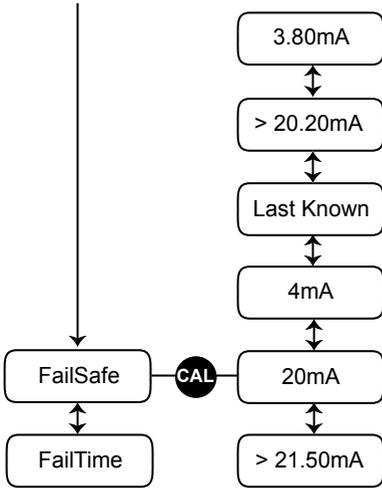


Advanced

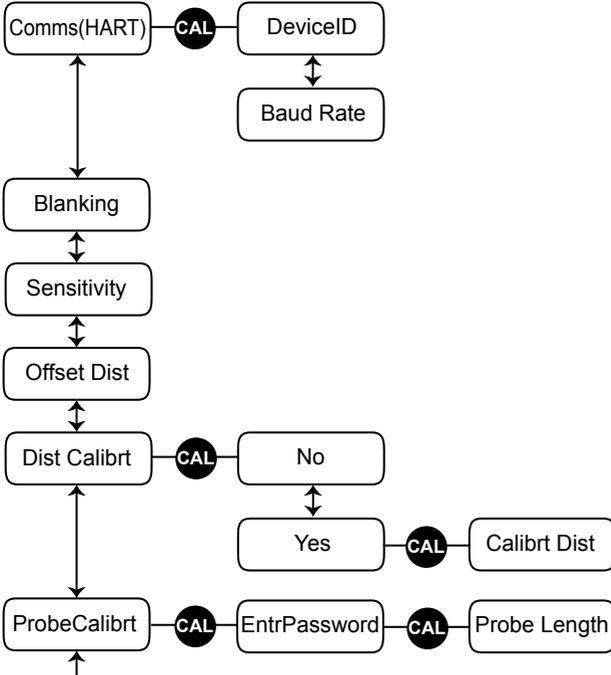

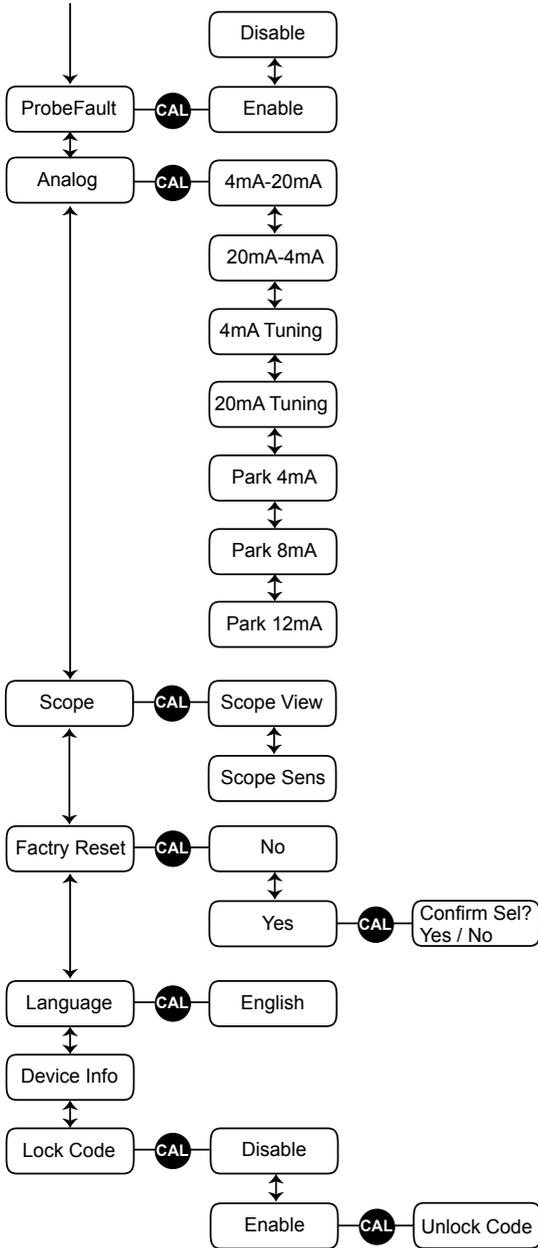





Diagnostics

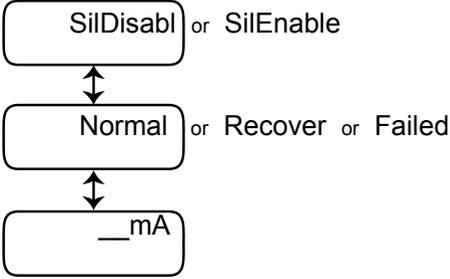


Setup

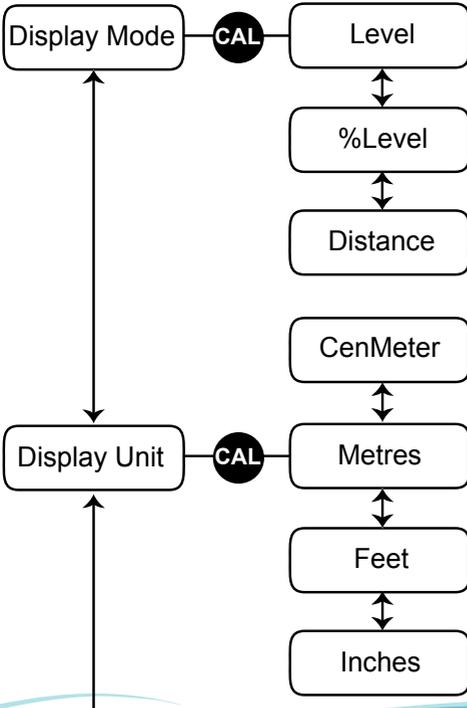


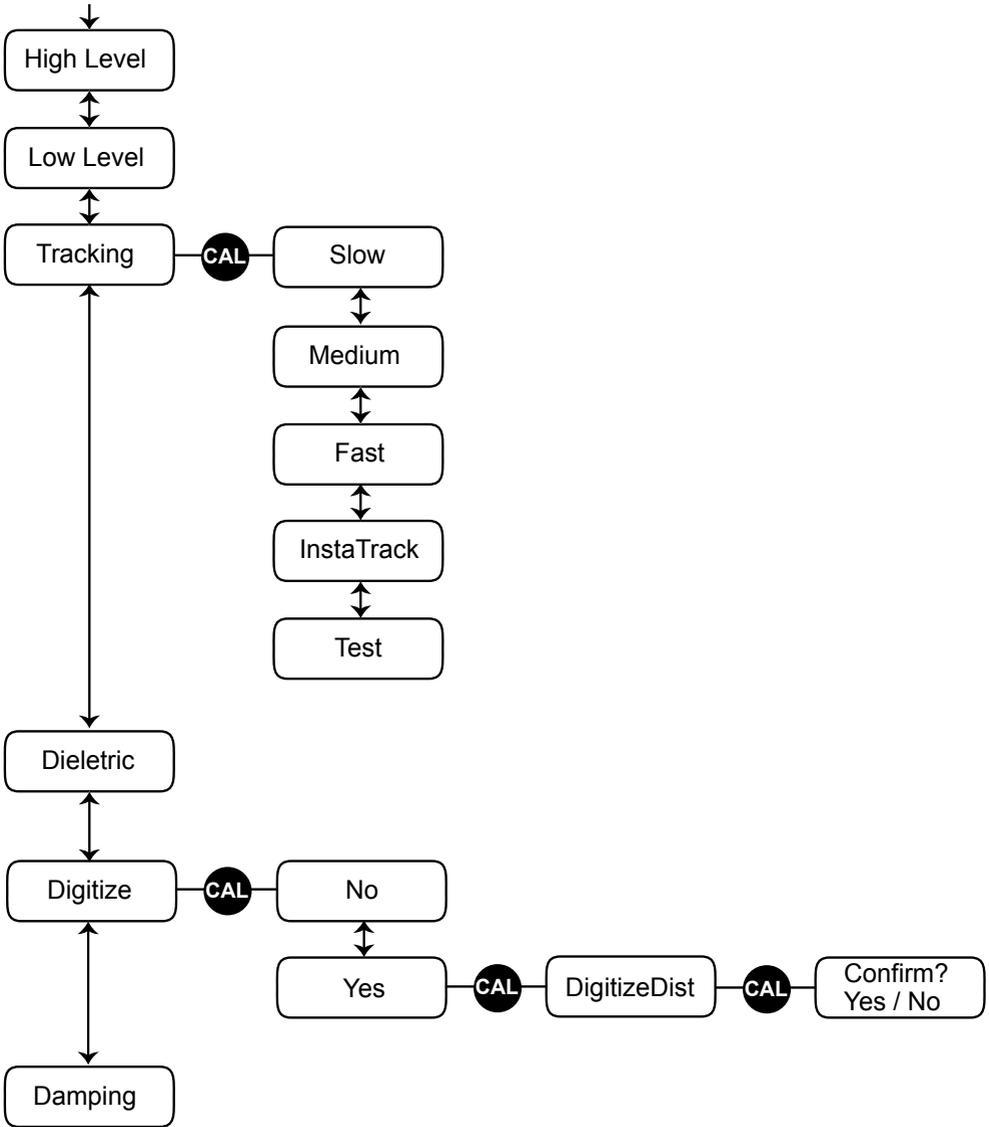




Advanced

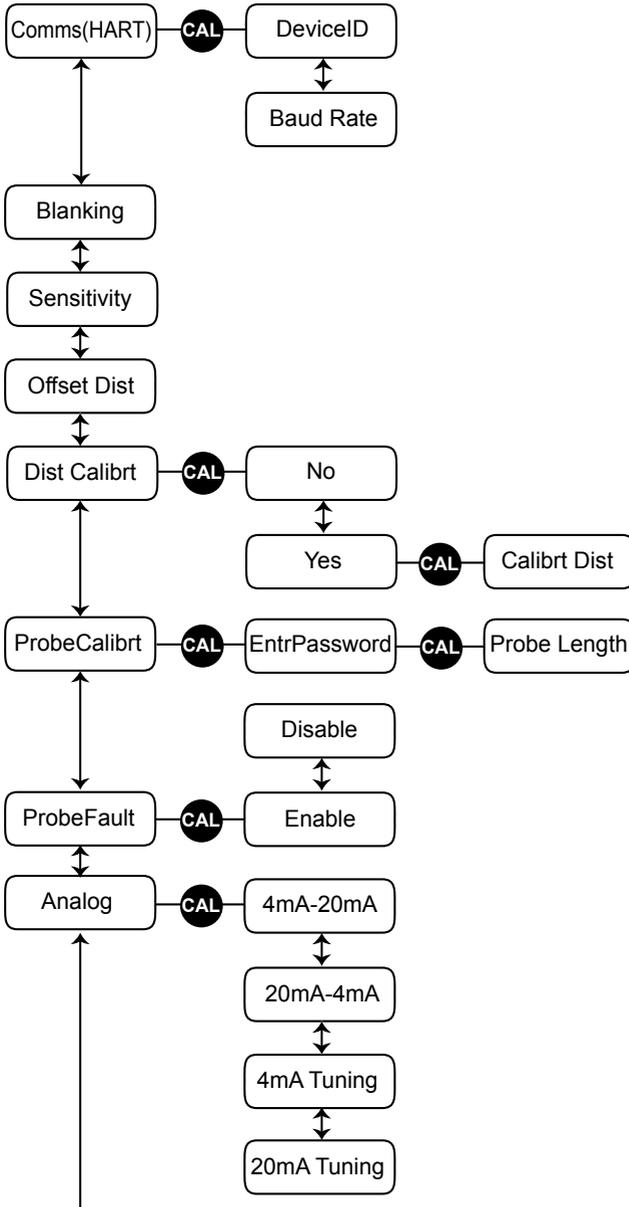

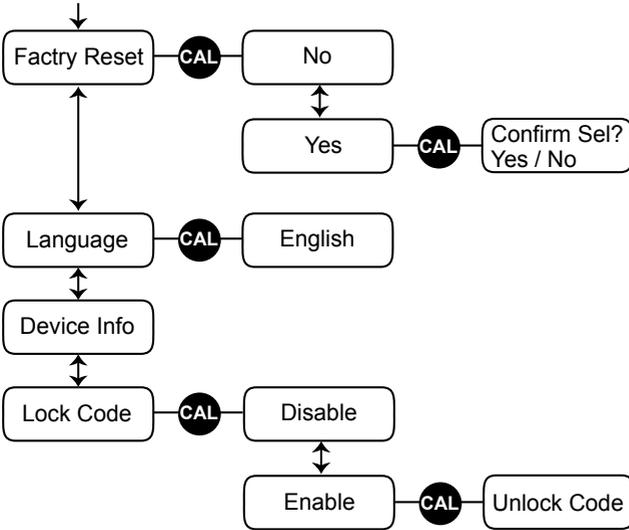



SILCommission

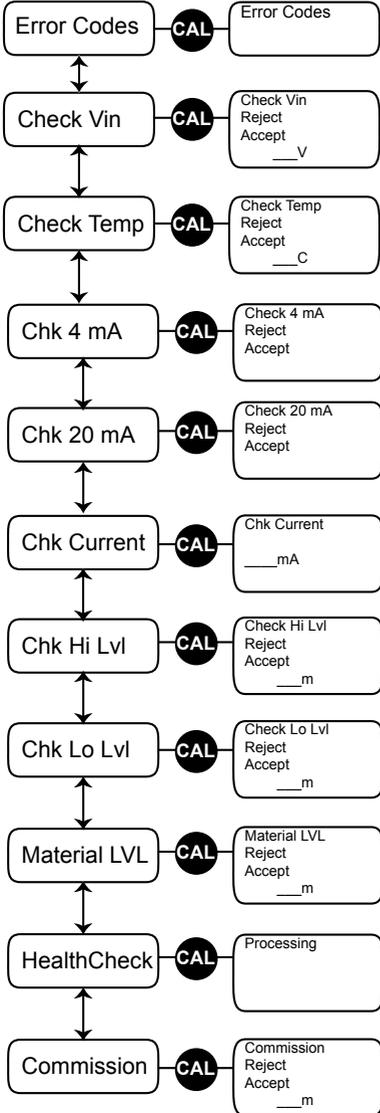



Failed codes

Error Code	Type	Description
Failed 01	Hardware	Pulse transmission error. If unit does not recover contact local representative for repair return
Failed 02	Hardware	Pulse transmission error. If unit does not recover contact local representative for repair return
Failed 03	Hardware	Pulse transmission error. If unit does not recover contact local representative for repair return
Failed 04	Hardware	Probe continuity error. Check probe is present or damaged. If unit does not recover contact local representative for repair return
Failed 05	Software	Memory corruption. Re-run Digitize routine. Perform Factory Reset and re-run Digitize routine. If unit does not recover contact local representative for repair return



General Troubleshooting

Problem	Check
<p>Display is blank Unit continually re-starts</p>	<p>Check incoming power on loop is to specification. Check incoming power on loop is continuous. Bench test with new 24V supply.</p>
<p>Measurement is non-responsive (material touching probe)</p>	<p>Run Digitize routine. If routine has already been run, Lower Dielectric selection or increase Sensitivity parameter. Check unit status for 'Failsafe'. The unit will go to Failsafe if it cannot detect any reflections. Check the probe element for damage or excessive build up. Ensure mounting is correct to specification with good ground reference. Ensure probe is not touching the vessel. Place current meter in line with loop. Ensure the 4-20mA is proportional to level reading based on High and Low level.</p>
<p>Unit is indicating a material level while no material is present</p>	<p>A) If the unit is indicating full / high Ensure no structure is making contact with the probe. Check for build up bridging between the probe and vessel / nozzle Run Digitize routine while no material is contacting the probe. Set Display Mode to Distance, note the measurement. If distance is near high level use Blanking to eliminate reflection interference. Adjust High level to ensure it is not within the Blanking range.</p> <p>B) If the unit is indicating other level The unit should measure the end of probe while nothing is touching the probe. Run Digitize routine while no material is contacting the probe. Confirm 'Low Level' is set correctly. Ensure no structure is making contact with the probe. Check for excessive build up and clean the probe. Ensure mounting is correct to specification with good ground reference. Place current meter in line with loop. Ensure the 4-20mA is proportional to level reading based on High and Low level. Use 4mA and 20mA tuning to force the output reading to each value to ensure the current control is operating correctly.</p>
<p>PLC reading does not match reading on display</p>	<p>Connect a Multimeter in series with the powered loop. Compare the 'mA' diagnostic on the display with the mA reading on the loop. If these values do not match, disconnect the loop wires and measure the resistance across the loop. This should not exceed specification. Confirm High Level and Low Level are set to the same values in CGR and control system.</p>



Troubleshooting (con't)

<p>Unit measurement is locked at or near end of probe</p>	<p>The material touching the probe may not be generating a large enough reflection in the application conditions.</p> <p>Ensure unit is mounted as per specifications. Take note of the ground reference requirement. Ensure the probe is not making contact with the vessel.</p> <p>Use a minimum 2" / 50mm flange to improve signal transmission.</p> <p>Change unit Tracking to 'Demo' mode to measure closest echo instead of largest. Increase Sensitivity.</p>
<p>The probe is too long</p>	<p>Non-hazardous rated units can have the probe length cut to requirement. For flexible probes release the cable weight by undoing grub screws.</p> <p>After adjusting the probe ensure the new probe length is recorded on site. Update ProbeCalibr parameter to new length.</p>
<p>Adjusting / commissioning the unit without removing the lid</p>	<p>You will require a HART to PC connector and HAWK GosHawkII software. See CGR GosHawk user manual' for further information.</p>
<p>Digitize fails</p>	<p>The digitization process will fail if the unit cannot detect a measurable difference between the largest false reflection and the reflection generated by either the end of probe or the material touching the probe.</p> <p>Choose a lower Dielectric pre-set and re-run Digitize.</p> <p>Increase Sensitivity value and re-run Digitize.</p> <p>Ensure the Digitize distance is not greater than the material level.</p> <p>Ensure no structure is making contact with the probe. Check for excessive build up and clean the probe.</p> <p>Ensure mounting is correct to specification with good ground reference.</p>
<p>Digitize displays incorrect distance</p>	<p>If Digitize displays a closer distance than the material level / end of probe enter the distance to the correct material level. The unit will automatically eliminate the detected echo and find the correct level.</p> <p>If Digitize displays a longer distance than the material level the measured material may not be returning a large enough signal. Increase Sensitivity and change Tracking to 'Test' mode. Ensure unit has conforming ground reference.</p> <p>If Digitize displays a longer distance than the end of the probe length adjust see 'Measurement Accuracy' below or the 'ProbeLength' parameter in 'Advanced' menu if the Probe length has been modified.</p>
<p>Measurement accuracy</p>	<p>Material / Dielectric or environment can create small measurement inaccuracy. Run Dist Calibr parameter in software to manually adjust measured distance to new value.</p>



Centurion Guided Radar System

HART Type - 3/4" & 1" Threaded Units (mounting option TN07, TB07, TN10, TB10)

Model

CGR2 2 wire Centurion Guided Radar

Communication

- H 4-20mA with HART
- I 4-20mA with HART and Interface Level
- L 4-20mA with HART and SIL2

Housing

- 1 Dual Chamber Aluminium Epoxy Painted with viewing window
- 2 Dual Chamber 316L Stainless Steel, with viewing window
- A Single Chamber Aluminium, powder coated with viewing window⁴
- B Single Chamber Aluminium powder coated, no viewing window⁴

Conduit / Gland Entry

- 1 1/2" NPT
- 3 M20 x 1.5

Probe Type

- A04 4mm flexible cable
- A06 6mm flexible cable
- B04 4mm rigid probe
- B06 6mm rigid probe
- J04 Detached 4mm flexible cable
- J06 Detached 6mm flexible cable
- K04 Detached 4mm rigid probe
- K06 Detached 6mm rigid probe

Probe variant / materials

- S 316L

Mounting

- TN07 3/4" NPT Thread (316L)
- TB07 3/4" BSP Thread (316L)
- TN10 1" NPT Thread (316L)
- TB10 1" BSP Thread (316L)
- FXXX¹ Integrated Flange (replace XXX with 3 character Integrated Flange Code)

Process O-ring seal / Process Temperature

- V1 FKM (Viton) (-40°C to +80°C) (-40°F to +176°F)
- V4 FKM (Viton) (-40°C to +150°C) (-40°F to +302°F)
- B1 NBR (-40°C to +80°C) (-40°F to +176°F)
- E1 EPDM (-40°C to +80°C) (-40°F to +176°F)
- E3 EPDM (-40°C to +130°C) (-40°F to +266°F)
- M1 FFKM (Markez) (-10°C to +80°C) (+14°F to +176°F)
- M4 FFKM (Markez) (-10°C to +150°C) (+14°F to +302°F)
- M5 FFKM (Markez) (-10°C to +200°C) (+14°F to +392°F)
- M6 FFKM (Markez) (-5°C to +250°C) (+23°F to +482°F) (Max Process Pressure 40 bar)
- S1 Silicone (-40°C to +80°C) (-40°F to +176°F)
- VG As per V1 plus 90° Display Orientation
- VJ As per V4 plus 90° Display Orientation
- BG As per B1 plus 90° Display Orientation
- EG As per E1 plus 90° Display Orientation
- EI As per E3 plus 90° Display Orientation
- MG As per M1 plus 90° Display Orientation
- MJ As per M4 plus 90° Display Orientation
- MK As per M5 plus 90° Display Orientation
- ML As per M6 plus 90° Display Orientation (Max Process Pressure 40 bar)
- SG As per S1 plus 90° Display Orientation



Process Pressure

- 1 6 bar
- 3 20 bar
- 4 40 bar
- 5 100 bar

Approval Standard

- XX Not Required
- 1D IECEx Ex ia/db [ja Ga] IIC T6...T2 Ga/Gb
- 2D IECEx Ex ia tb [ja Da] IIIC T85°C...T250°C Da Db
- 1U FM XP Cl I, Div 1, Gp B-D with IS Probe Cl I, Div I, Gp A-D, T6...T2B, Ta = T* to 60°C; Cl. I Zone 0/1 AEx ia/db [ja Ga] IIC T6...T2 Ga/Gb
- 2U FM DIP-IS, Cl II, III, Div 1, Grp E, F and G, T6...T2B, Ta = T* to +60°C; Zone 20/21 AEx ia IIIC T85°C...T250°C Da; AEx tb IIIC T85°C Db, Ta = T* to +60°C
- 1C CSA XP Cl I, Div 1, Gp B-D with IS Probe Cl I, Div I, Gp A-D, T6...T2B³
- 2C CSA Ex ia/db IIC T6...T2 Ga/Gb³
- 3C CSA DIP-IS, Class II, III, Division 1, Groups E, F and G, T6...T2B³
- 4C CSA Ex ia IIIC T85°C...T250°C Da; Ex tb IIIC T85°C Db³
- GP FM/CSA General Purpose
- 1A ATEX II 1/2 G Ex ia/db IIC T6...T2 Ga/Gb
- 2A ATEX II 1/2 D Ex ia IIIC T85°C...T250°C Da / Ex tb IIIC T85°C Db
- 3A ATEX II 3G Ex ia/db IIC T6...T2 Gc Tamb -40°C to 60°C
- 6A ATEX II 3D Ex ia IIIC T85°C...T255°C Dc Tamb -40°C to 60°C, Ex tb IIIC T85°C Dc

Probe Length

Specify in cm

CGR2 H 1 3 B04 S TN10 B1 1 XX 200

Probe / Mounting Combination Table

Probe Code	Variant / Materials	Mounting	Flange Sizes ²		Max. Length
			Min. Size	Max size	
A04 / J04	S	TN07, TB07, FXXX	1", DN25, 25mm	4", DN100, 100mm	1850cm
A06 / J06	S	TN10, TB10	2", DN50, 50mm	4", DN100, 100mm	1850cm
B04 / K04	S	TN07, TB07, FXXX	1", DN25, 25mm	4", DN100, 100mm	400cm
B06 / K06	S	TN10, TB10	2", DN50, 50mm	4", DN100, 100mm	400cm

¹See Integrated Flange Code selection in Flange Table.

²Hawk Supplied Flanges. End user can use any appropriate flange with suitable bore hole.

³NPT conduit / cable thread only

⁴Hazardous Approval option 'XX, 6A' only

**Refer to Safety Instructions



Centurion Guided Radar System

HART Type - 1.5" Threaded Units (mounting option TN15/TB15)

Model

CGR2 2 wire Centurion Guided Radar

Communication

- H 4-20mA with HART
- I 4-20mA with HART and Interface Level
- L 4-20mA with HART and SIL2

Housing

- 1 Dual Chamber Aluminium, Epoxy Painted with viewing window
- 2 Dual Chamber 316L Stainless Steel with viewing window
- A Single Chamber Aluminium, powder coated with viewing window⁴
- B Single Chamber Aluminium, powder coated, no viewing window⁴

Conduit Gland Entry

- 1 1/2" NPT
- 3 M20 x 1.5

Probe Type

- A08 8mm flexible cable
- B08 8mm rigid probe
- J08 Detached 8mm flexible cable
- K08 Detached 8mm rigid probe

Probe variant / materials

- S 316L

Mounting

- TN15 1.5" NPT Thread (316L)
- TB15 1.5" BSP Thread (316L)
- XXXX¹ Pre-Integrated Flange (replace XXX with 3 character Integrated Flange Code)

Process O-ring seal / Process Temperature

- V1 FKM (Viton) (-40°C to +80°C) (-40°F to +176°F)
- V3 FKM (Viton) (-40°C to +130°C) (-40°F to +266°F)
- B1 NBR (-40°C to +80°C) (-40°F to +176°F)
- E1 EPDM (-40°C to +80°C) (-40°F to +176°F)
- E3 EPDM (-40°C to +130°C) (-40°F to +266°F) (Maximum Process Pressure 6 bar)
- S1 Silicone (-40°C to +80°C) (-40°F to +176°F)
- S3 Silicone (-40°C to +130°C) (-40°F to +266°F) (Maximum Process Pressure 6 bar)
- VG As per V1 plus 90° Display Orientation
- VI As per V3 plus 90° Display Orientation
- BG As per B1 plus 90° Display Orientation
- EG As per E1 plus 90° Display Orientation
- EI As per E3 plus 90° Display Orientation
- SG As per S1 plus 90° Display Orientation
- SI As per S3 plus 90° Display Orientation

Process Pressure

- 1 6 bar (87 psig)
- 3 20 bar (290 psig)
- 4 40 bar (580 psig)

Approval Standard

- XX Not Required
- 1D IECEx Ex ia/db [ia Ga] IIC T6...T2 Ga/Gb
- 2D IECEx Ex ia tb [ia Da] IIIC T85°C...T250°C Da Db
- 1U FM XP Cl I, Div 1, Gp B-D with IS Probe Cl I, Div I, Gp A-D, T6...T2B, Ta = T* to 60°C; Cl. I Zone 0/1 AEx ia/db [ia Ga] IIC T6...T2 Ga/Gb
- 2U FM DIP-IS, Cl II, III, Div 1, Grp E, F and G, T6...T2B, Ta = T* to +60°C; Zone 20/21 AEx ia IIIC T85°C...T250°C Da; AEx tb IIIC T85°C Db, Ta = T* to +60°C

¹See Integrated Code selection in Flange Table.

²NPT conduit / cable thread only

⁴Not available with Hazardous Approvals

**Refer to Safety Instructions



- 1C CSA XP Cl I, Div 1, Gp B-D with IS Probe Cl I, Div I, Gp A-D, T6...T2B³
- 2C CSA Ex ia/db IIC T6...T2 Ga/Gb³
- 3C CSA DIP-IS, Class II, III, Division 1, Groups E, F and G, T6...T2B³
- 4C CSA Ex ia IIIC T85°C...T250°C Da; Ex tb IIIC T85°C Db³
- GP FM/CSA General Purpose
- 1A ATEX II 1/2 G Ex ia/db IIC T6...T2 Ga/Gb
- 2A ATEX II 1/2 D Ex ia IIIC T85°C...T250°C Da / Ex tb IIIC T85°C Db
- 3A ATEX II 3G Ex ia/db IIC T6...T2 Gc Tamb -40°C to 60°C
- 6A ATEX II 3D Ex ia IIIC T85°C...T255°C Dc Tamb -40°C to 60°C, Ex tb IIIC T85°C Dc

Probe Length

Specify in cm

CGR2 H 1 3 B08 S TN15 B1 1 XX 200

Probe / Mounting Combination Table

Probe Code	Variant / Materials	Mounting	Flange Sizes ²		Max. Length
			Min. Size	Max size	
A08 / J08	S	TN15, TB15, FXXX	2", DN50, 50mm	4", DN100, 100mm	1850cm
B08 / K08	S	TN15, TB15, FXXX	2", DN50, 50mm	4", DN100, 100mm	400cm

¹See Integrated Code selection in Flange Table.

²Hawk Supplied Flanges. End user can use any appropriate flange with suitable bore hole.

³NPT conduit / cable thread only

⁴Hazardous Approval option 'XX, 6A' only

**Refer to Safety Instructions



Mounting Flanges

Threaded Flanges

Model

FLA - Flange Size

- 1 1" or DN25 or 25mm
- H 1 1/2" or DN40 or 40mm
- 2 2" or DN50 or 50mm
- K 2 1/2" or DN65 or 65mm
- 3 3" or DN80 or 80mm
- L 3 1/2" (ANSI ONLY)
- 4 4" or DN100 or 100mm

Flange Type

- A1 ANSI B16.5 150LB FLANGE
- A3 ANSI B16.5 300LB FLANGE
- A6 ANSI B16.5 600LB FLANGE
- A9 ANSI B16.5 900LB FLANGE
- AA ANSI B16.5 1500LB FLANGE
- AB ANSI B16.5 2500LB FLANGE
- D6 DIN2527 PN6 FLANGE
- D0 DIN2527 PN10 FLANGE
- D1 DIN2527 PN16 FLANGE
- D2 DIN2527 PN25 FLANGE
- D4 DIN2527 PN40 FLANGE
- J5 JIS 5K FLANGE
- J0 JIS 10K FLANGE
- J1 JIS 16K FLANGE
- J2 JIS 20K FLANGE
- J4 JIS 40K FLANGE
- S1 AS 2129 Table D
- S2 AS 2129 Table E
- S3 AS 2129 Table F
- S4 AS 2129 Table H

Material

- SS SS316L

Thread Type

- TB07 3/4" BSP THDs
- TB10 1" BSP THDs
- TB15 1 1/2" BSP THDs
- TN07 3/4" NPT THDs
- TN10 1" NPT THDs
- TN15 1 1/2" NPT THDs

FLA - 2 A1 - SS - TB15

Integrated Flanges

Model

F Flange Size

- 1 1" or DN25 or 25mm
- H 1 1/2" or DN40 or 40mm
- 2 2" or DN50 or 50mm
- K 2 1/2" or DN65 or 65mm
- 3 3" or DN80 or 80mm
- L 3 1/2" (ANSI ONLY)
- 4 4" or DN100 or 100mm

Flange Type

- A1 ANSI B16.5 150LB FLANGE
- A3 ANSI B16.5 300LB FLANGE
- A6 ANSI B16.5 600LB FLANGE
- A9 ANSI B16.5 900LB FLANGE
- AA ANSI B16.5 1500LB FLANGE
- AB ANSI B16.5 2500LB FLANGE
- D6 DIN2527 PN6 FLANGE
- D0 DIN2527 PN10 FLANGE
- D1 DIN2527 PN16 FLANGE
- D2 DIN2527 PN25 FLANGE
- D4 DIN2527 PN40 FLANGE
- J5 JIS 5K FLANGE
- J0 JIS 10K FLANGE
- J1 JIS 16K FLANGE
- J2 JIS 20K FLANGE
- J4 JIS 40K FLANGE
- S1 AS 2129 Table D
- S2 AS 2129 Table E
- S3 AS 2129 Table F
- S4 AS 2129 Table H

F 2 D4

Accessories

Tank Fastening Kit

CGR-A0X-WL-SS

Kit includes:

Qty1 RIGGING-SCR-JAW-JAW-SS-M12

Qty2 EYEBOLT-SS-M10

Specifications

Centurion Guided Radar



Electronics

Power

- 2 wire loop powered
- 24VDC (14 to 28VDC)

Power Consumption

- <500mW @ 24VDC

Analog Output

- 14V @ 0 Ohm
- 19V @ 250 Ohms
- 24V @ 500 Ohms
- Current park at 4mA, 8mA, 12mA

Communications

- HART (Revision 7)
- GosHawkII via HART. Full parameter list

Maximum Range

- Flexible cable probe: 18.5m (60ft 8in)
- Rigid probe: 4m (13ft 1in)

Minimum Range (Blanking)

- >=150mm (6")

Dielectric Range

- ≥ 1.5

Frequency

- 2.2 GHz

Resolution

- Analog: 1uA
- Display: 1.0mm

Accuracy¹

- +/- 3mm

Measurements per second

- 3

Response Time

- <1 second (based on application selection)

Sum of non linearity, non repeatability, hysteresis

- Analog +/- 0.02%

Repeatability

- +/- 3mm

Memory

- Non-Volatile (No backup battery required)
- >10 years data retention

Operating Temperature (Electronics)

- -40°C to +80°C (-40 to +176°F)

Display

- 4 line graphic display (128 x 64 pixels)

Language

- English

Configuration

- 4 button (Up, Down, Cal, Run), GosHawkII via HART, HART 7 DD/DTM

Approvals

• Certificate No. IECEx TSA 14.0037X

IECEx Zone 0/1, Zone 1

Ex ia/d [ia Ga] IIC T6...T2 Ga/Gb Tamb = -40°C to +60°C

IECEx Zone 20/21

Ex ia tb [ia Da] IIIC T85°C...T255°C Da Db Tamb = -40°C to +60°C

• Certificate No. FM18US0194X

FM Class I Div 1 & Class I, Zone 0/1

XP Cl. I Div 1 Gp B-D with IS Probe Cl I, Div I, Gp A-D, T6...T2B Ta = -33°C to +60°C
Cl I, Zone 0/1 AEx ia/db IIC T6...T2 Ga/Gb Ta = -33°C to +60°C

FM Class II,III Div 1 & Zone 20/21

DIP-IS Class II, III, Division 1, Groups E,F and G T6...T2B Ta = -33°C to +60°C
Zone 20/21 AEx ia IIIC T85°C...T255°C Da; AEx tb IIIC T85°C Db, Ta = -33°C to +60°C

• Certificate No. FM18CA0091X

CSA Class I Div 1

XP-AIS Cl. I Div 1 Grp B-D with IS Probe Cl I, Div I, GP A-D, T6...T2B
Ta = -33°C to +60°C

CSA Class I, Zone 0/1

Ex ia/db IIC T6...T2 Ga/Gb Ta = -33°C to +60°C

CSA Class II,III Div 1

DIP-IS Cl. II,III Div 1 Groups E, F and G T6...T2B Ta = -33°C to +60°C

CSA Zone 20/21

Ex ia IIIC T85°C...T250°C Da; Ex tb T85°C, Db Ta = -33°C to +60°C

• Certificate No. FM18ATEX0046X

ATEX Ex II 1/2 G Ex ia/db IIC T6...T2 Ga/Gb Ta = -33°C to +60°C
ATEX Ex II 1/2 D Ex ia IIIC T85°C...T250°C Da; Ex tb IIIC T85°C Db
Ta = -33°C to +60°C

• Certificate No. FM18NUS0014

FM General Purpose

FM Class 3810: 2018, ANSI/ISA 61010-1: 2012, ANSI/NEMA
250:2003, ANSI/IEC 60529:2004

• Certificate No. FM18NCA0005

CSA General Purpose

CSA-C22.2 No. 94:2011, CSA-C22.2 No. 60529:2010, CAN/
CSA-C22.2 No. 61010-1:2012

• Self Declaration

ATEX II 3G Ex ia/db IIC T6... T2 Gc Tamb -40°C to 60°C
ATEX II 3D Ex ia IIIC T85°C... T255°C Dc Tamb -40°C to 60°C, Ex tb
IIIC T85°C Dc



Centurion Guided Radar



Level measurement of liquids, sludge,
powders and granules to a distance of
18.5 metres.



Ordering Instructions

Centurion Guided Radar



Ordering Instructions

Threaded unit type

Assemble part number taking note of the valid combinations and exclusions for the full system.

The unit is ordered as a single line item. For example:

CGR2H13B08STB15B11XX200

Flanged type - Threaded flange

Assemble part number taking note of the valid combinations and exclusions for the full system. The unit and the threaded flange are ordered as separate line items. For example:

CGR2H13B08STTN15B11XX200

FLA-FA4-SS-TN15

or

CGR2H13B08STTN07B11XX200

FLA-FA1-SS-TN07

Flanged type - Integrated flange

Assemble part number taking note of the valid combinations and exclusions for the full system.

In the Mounting part code enter 4 character integrated flange code from the table. All integrated flanges have F as the first character. For example:

CGR2H13B08SF4A1B11XX200

All company or product names are registered trademarks or trademarks of their respective owners.

Hawk Measurement Systems (Head Office)

15 - 17 Maurice Court
Nunawading VIC 3131, AUSTRALIA

Phone: +61 3 9873 4750

Fax: +61 3 9873 4538

info@hawk.com.au

Hawk Measurement

90 Glenn Street
Suite 100B, Lawrence, MA 01843, USA

Phone: +1 888 HAWKLEVEL (1-888-429-5538)

Phone: +1 978 304 3000

Fax: +1 978 304 1462

info@hawkmeasure.com

Technical data subject to change without notice.